

OTHER UNDERGROUND METER BASE MOUNTING OPTIONS

METER BASE SPECIFICATIONS :

- METER BASE SIZE TO BE COORDINATED WITH VEC FOR LOADING
- METER SOCKET MUST BE A PLUG IN TYPE METER, RING OR RINGLESS
- METER BASE MUST BE MOUNTED PER NATIONAL ELECTRIC CODE
- METER BASE DISCONNECT MAY BE MOUNTED AS AN ALL IN ONE OR WITH METER BASE AND DISCONNECT SEPARATED


SLIP JOINT REQUIRED TO BE ATTACHED AT BOTTOM OF METER BASE

ALL CLAMPS TO BE DETERMINED BY NATIONAL ELECTRIC CODES

ALL CUST. OWNED PIPE TO BE DETERMINED BY NATIONAL ELECTRIC CODES

FINAL GRADE

FINAL GRADE

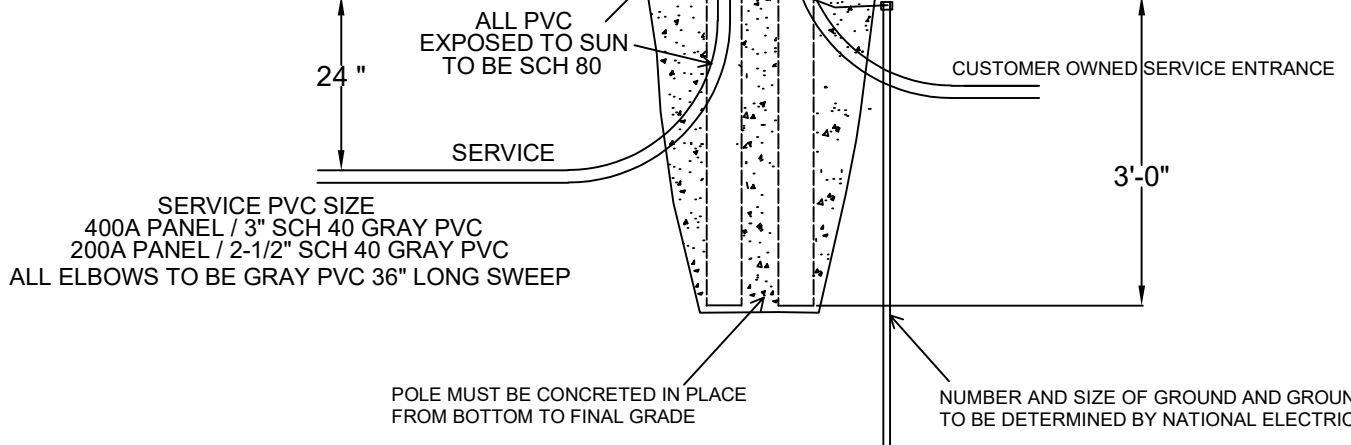

ALL SERVICE AND SECONDARY PIPES MUST HAVE A PULL STRING

METER BASE POLE INSTALLED BY CUSTOMER AND INSPECTED BY STATE INSPECTOR

NOT TO SCALE

SINGLE PHASE PERMANENT UNDERGROUND  
METER BASE ON A POLE



DRAWN BY: DLB

REVISED: 8/19/24